



Top View

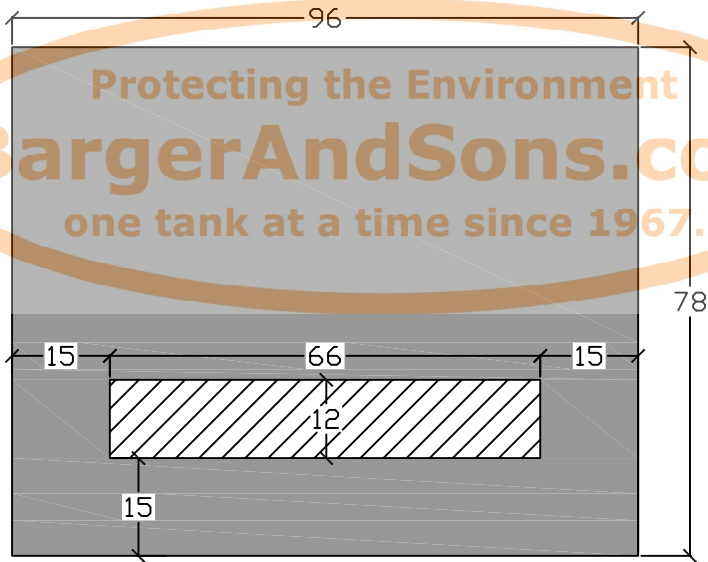

Front View

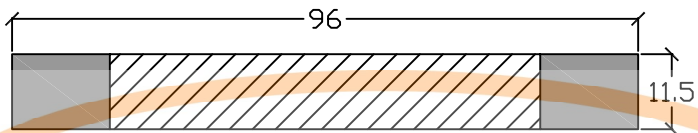

**Specifications**

**Concrete:** 5,000 psi minimum strength (28 day)

**Reinforcing:** Primary reinforcement will be #3 rebar (Grade 60) rebar that will reinforce the sides and ends. The rebar will be on 12" centers running the width and length of the pad. All splices will be overlapped 40 bar diameters.

**Lifting Devices:** Each individual lifting device used will be constructed of ASTM A36.

Manufactured by:  
**C.R. Barger & Sons, Inc.**  
 123Pawnook Farm Road  
 Lenoir City TN 37771  
**Phone** 865.882.5860 **Fax** 865.882.6394  
 www.BargerAndSons.com

General Notes:  
 All vertical measurements are accurate within  $\pm 1/2$  inch. The lids can be moved and resized if necessary. Written specifications are available upon request.

Tank Type: LCUB Transformer Pad 96" x 78"	
Date: 7.072009	Approx. Weight: 6,600 lb.
Drawn By: Eric Barger	Build: LCUB