




Top View

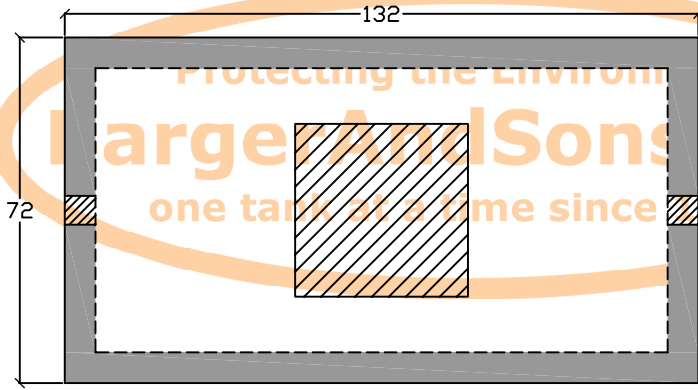


End View

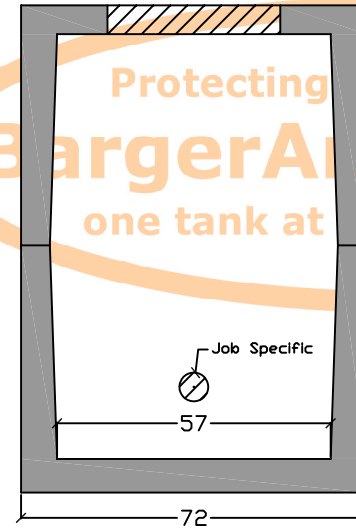

Side View

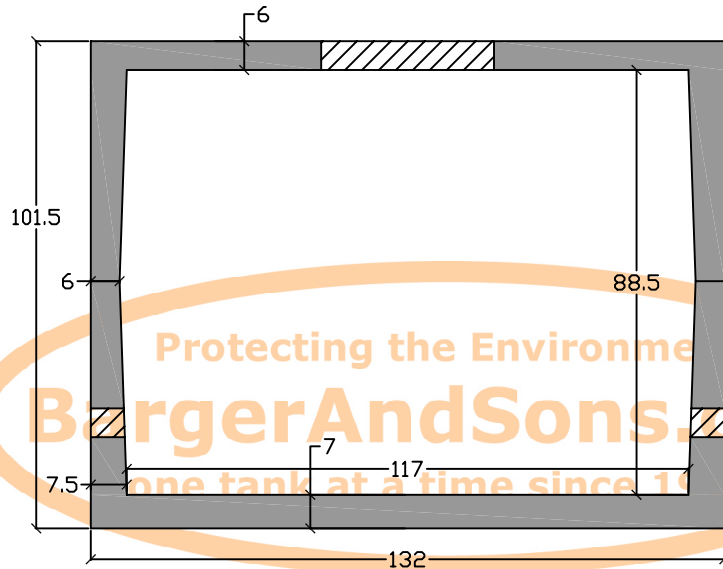

Controlled Expansion Hydrophilic Waterstop



Specifications

Concrete: 5,000 psi minimum strength (28 day)

Reinforcing: Primary reinforcement will be per engineers reinforcement design. All splices will be overlapped 40 bar diameters.

Pipe Penetrations: The inlet and outlet are fitted with seals that meet or exceed ASTM C923. All pipe penetrations are placed according to job requirements.

Meter Box Lid: The meter box lid will be an H-20 rated lid cast-in-place in the lid top. Lids can be positioned in the top according to job requirements.

All traffic rated lids are special order.



Manufactured by:
C.R. Barger & Sons, Inc.
 238 Mays Valley Road
 Harriman Tn 37748
Phone 865.882.5860 Fax 865.882.6394
 www.bargerandsons.com

General Notes:
 All vertical measurements are accurate within ± 1 inch on the tank. The lids can be moved and resized if necessary. Written specifications are available upon request.

Tank Type: Meter Pit 2500 H-20 Traffic Rated	
Date: 3.232006	Approx. Weight: 32,000 lbs.
Drawn By: Eric Barger	Sub-type: Mid Seam