



Top View

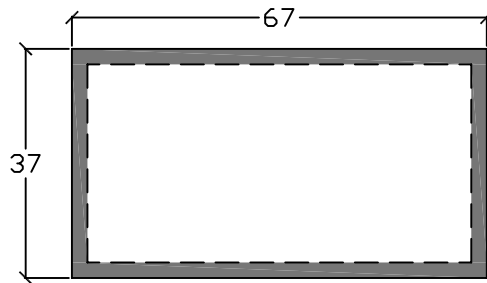

End View



Specifications

Concrete: 5,000 psi minimum strength (28 day)


Reinforcing: Primary reinforcement will be a #3 rebar (Grade 60) rebar that will reinforce the sides and bottom.

Pipe Penetrations: All pipe penetrations are placed according to job requirements.

Meter Box Lid: The meter box lid will be an aluminum bilco lid with a load rating of 150 p.s.f. Lids can be drop-in-place or cast-in-place and positioned in the top according to job requirements.

General: Meter vaults are not water tight structures unless specified.

Side View

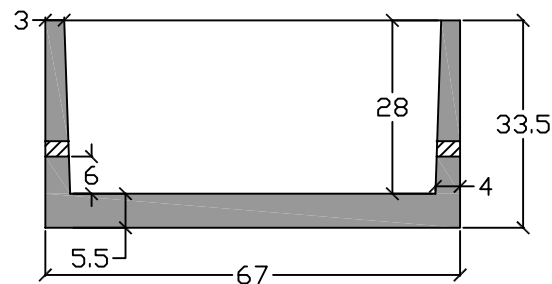

Manufactured by:
C.R. Barger & Sons, Inc.
 P.O. Box 370
 Kingston TN 37763
Phone 865.270.8080 Fax 865.270.8079
 www.BargerAndSons.com

General Notes:
 All vertical measurements are accurate within \pm 1/2 inch on the tank. Written specifications are available upon request.

Tank Type: Meter Pit (33.5" tall)	
Date: 8.042008	Approx. Weight: 2,000 lbs.
Drawn By: Eric Barger	Build: Single Compartment