




Top View

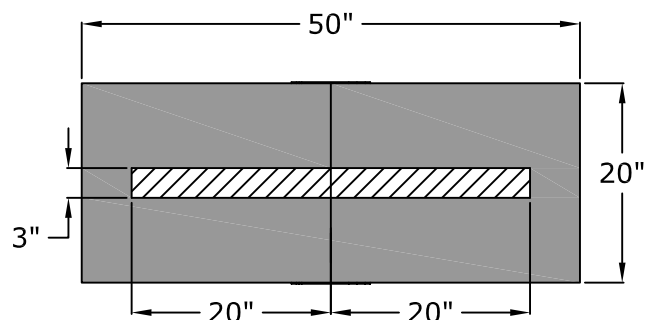

End View



Side View

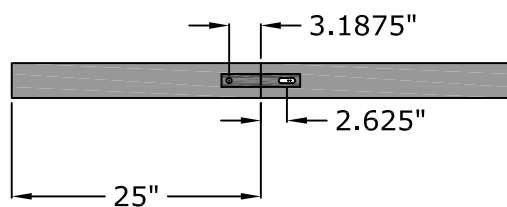

Approved for Production

Project: _____

Quantity: _____

Date: _____

By: _____

Specifications

Concrete: 4,000 psi minimum strength (28 day)

Reinforcing: Primary reinforcement will be a #3 rebar (Grade 60) rebar.

Pipe Penetrations: The inlet and outlet are fitted with open slots.

Sealant: Sealant used will meet or exceed ASTM C990.



C.R. Barger & Sons, Inc.
P.O. Box 370 - Kingston TN 37763
Phone 888.882.5860 - BargerAndSons.com

20" x 50" Backflow Mounting Pad 2 - Piece

Date: 2.232009

Drawn By: Eric Barger

Approx. Vault Weight: 1200 lbs.