



Top View

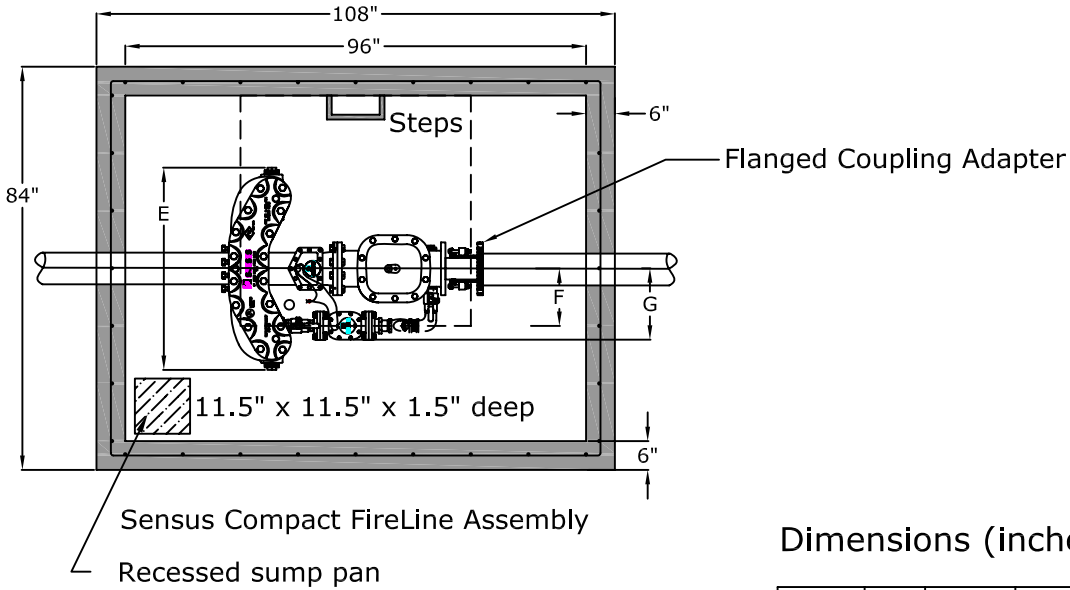

Dimensions (inches)


Size	A	B	C	D	E	F	G
8"	53	24	6.75	6.75	45.5	13.65	17

Side View

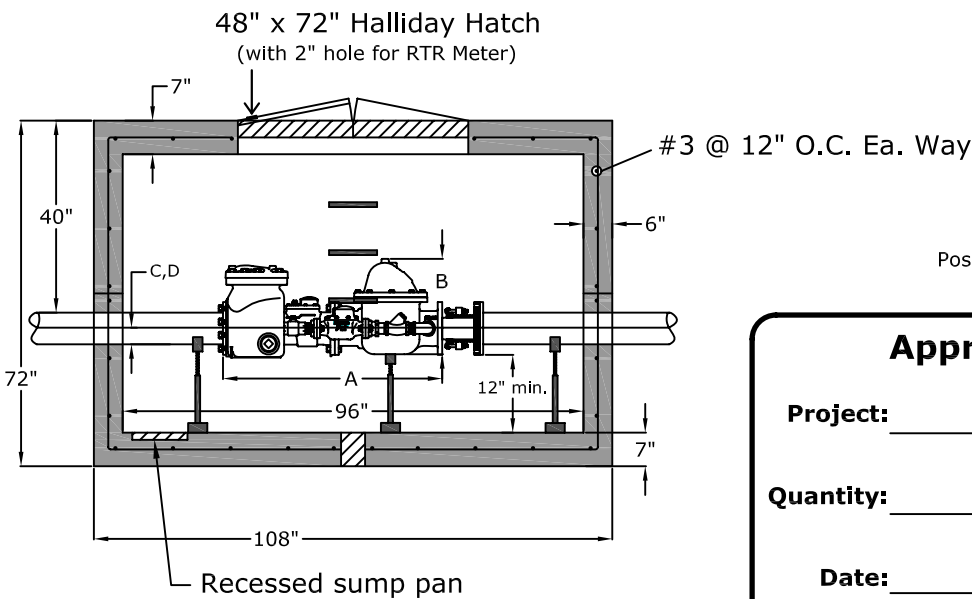

Joint Detail

Positive Lock Male/Female Keyway
 +/- 0.005" tolerance



Approved for Production

Project: _____

Quantity: _____

Date: _____

By: _____



Protecting the Environment
BargerAndSons.com
 one tank at a time since 1967.

C.R. Barger & Sons, Inc.
 P.O. Box 370 - Kingston TN 37763
 Phone 888.882.5860 - BargerAndSons.com

Specifications

- Concrete:** 5,000 psi minimum strength (28 day)
- Reinforcing:** Primary reinforcement will be a #3 rebar (Grade 60) rebar.
- Pipe Penetrations:** The inlet and outlet are fitted with solid seals that meet or exceed ASTM C923 (4" D.I.P. - 8" D.I.P.). All pipe penetrations are placed according to job requirements.
- Pipe Stands:** Adjustable height pipe stands will be provided to support assembly.
- Sealant:** Sealant used will meet or exceed ASTM C990.
- Steps:** Aligned under hatch unless specified.

**8' x 6' Fire Meter Vault - 8"
 Hendersonville Utility District**

Date: 10.092008 Drawn By: Eric Barger Approx. Vault Weight: 22,000 lbs.